

EUROPEAN UNION RULE OF LAW MISSION IN KOSOVO

EULEX KOSOVO

Ndertesë Farmë
"Muharrem Fejza" p.n.
Lagja e Spitalit
10000 Pristina, Kosovo
www.eulex-kosovo.eu


CORRIGENDUM (1)

PUBLICATION REFERENCE: PROC/374/12/Supply Installation and Maintenance of Water Fire Hydrants (EuropeAid/133718/L/SUP/XK)

The following corrections are made to the Annex VI – Illustration Photos

Previous Illustration Photo "Above ground fire hydrant - installation details"

**Above ground fire hydrant
Installation details**

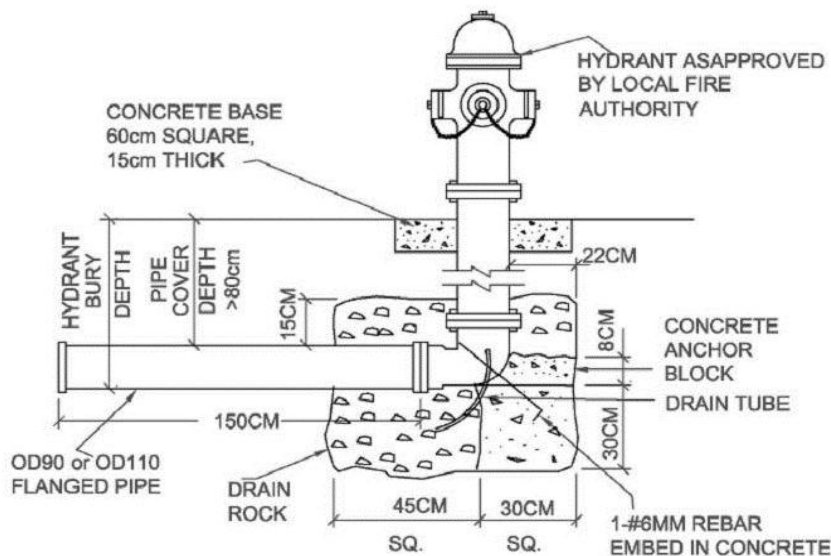


DN80 or DN100 ABOVE GROUND HYDRANT

NO TO SCALE


New - Illustration Photo “Above ground fire hydrant - installation details”:

Above ground Fire Hydrant Installation details

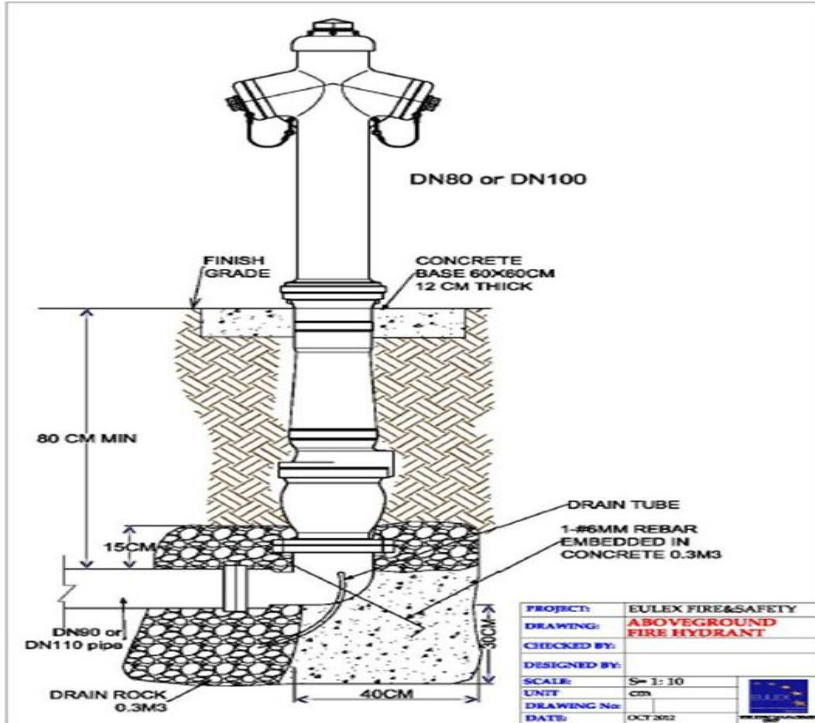

Previous Illustration Photo “Trench restoration – installation details”

Trench restoration Installation details

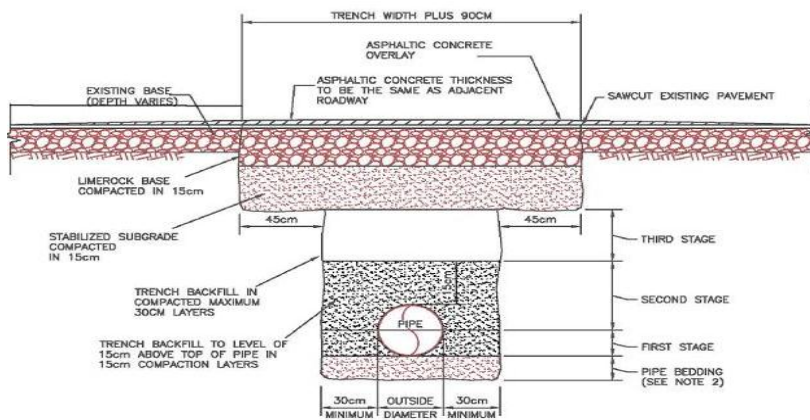


NOTES:

1. BACKFILL SHALL BE OF SUITABLE MATERIAL REMOVED FROM EXCAVATION EXCEPT WHERE OTHER MATERIAL IS SPECIFIED. BACKFILL MATERIAL SHALL CONSIST OF EARTH, LOAM, SANDY CLAY, GRAVEL, CRUSHED LIMESTONE, OR OTHER APPROVED MATERIAL. REFER TO TECHNICAL SPECIFICATIONS FOR DETAIL REQUIREMENTS.
2. IF TRENCH BOTTOM CONTAINS ROCK, THEN A MINIMUM OF A 15CM PIPE BEDDING SHALL BE USED.

**TRENCH RESTORATION
DETAIL FOR ROADS**
RTS

New - Illustration Photo “Trench restoration – installation details”:

**Trench Restoration
Installation Details**

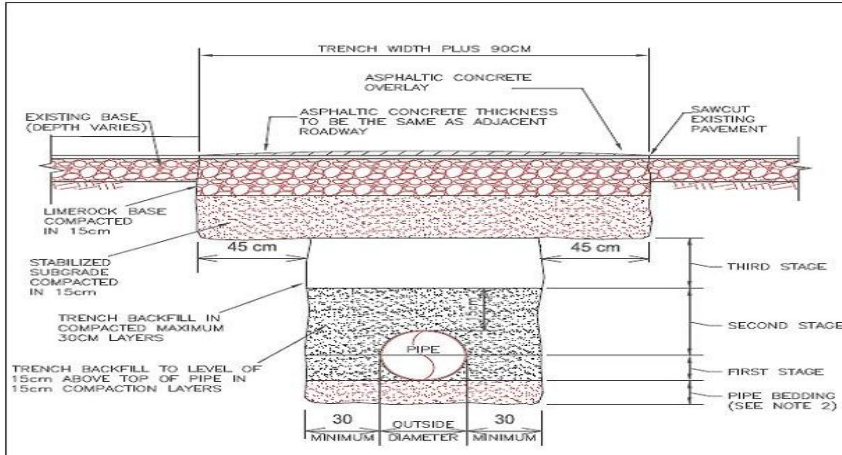

NOTES:

1. BACKFILL SHALL BE OF SUITABLE MATERIAL REMOVED FROM EXCAVATION EXCEPT WHERE OTHER MATERIAL IS SPECIFIED. BACKFILL MATERIAL SHALL CONSIST OF EARTH, LOAM, SANDY CLAY, GRAVEL, CRUSHED LIMESTONE, OR OTHER APPROVED MATERIAL. REFER TO TECHNICAL SPECIFICATIONS FOR DETAIL REQUIREMENTS.
2. IF TRENCH BOTTOM CONTAINS ROCK, THEN A MINIMUM OF A 15CM PIPE BEDDING SHALL BE USED.


**TRENCH RESTORATION
DETAIL FOR ROADS**
NTS

PROJECT:	EULEX FIRE&SAFETY
DRAWING:	TRENCH DETAIL
CHECKED BY:	
DESIGNED BY:	
SCALE:	NTS
UNIT:	cm
DRAWING No:	
DATE:	OCT 2012



Previous Illustration Photo “Underground fire hydrant - installation details”

**Underground fire hydrant
Installation details**

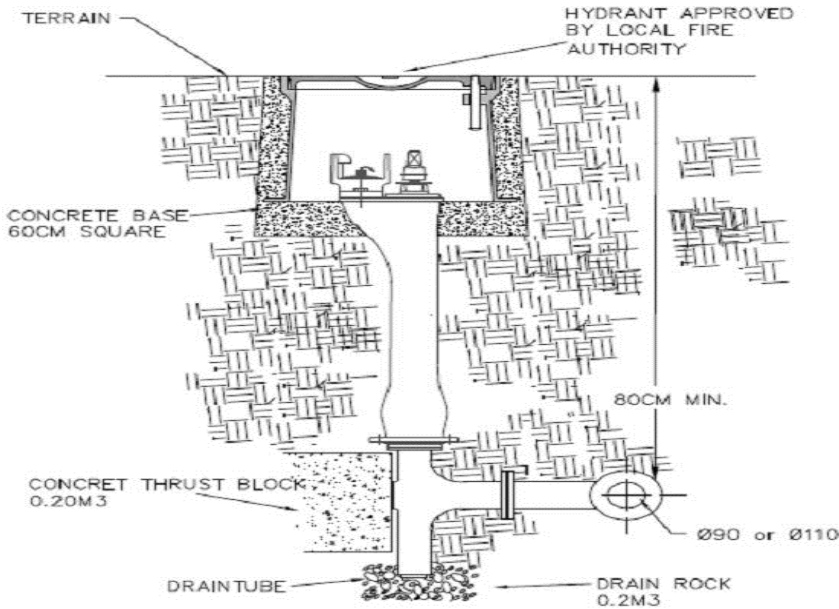


UNDERGROUND FIRE HYDRANT

NO to SCALE

New - Illustration Photo “Underground fire hydrant - installation details”:

Underground Fire Hydrant
Installation details

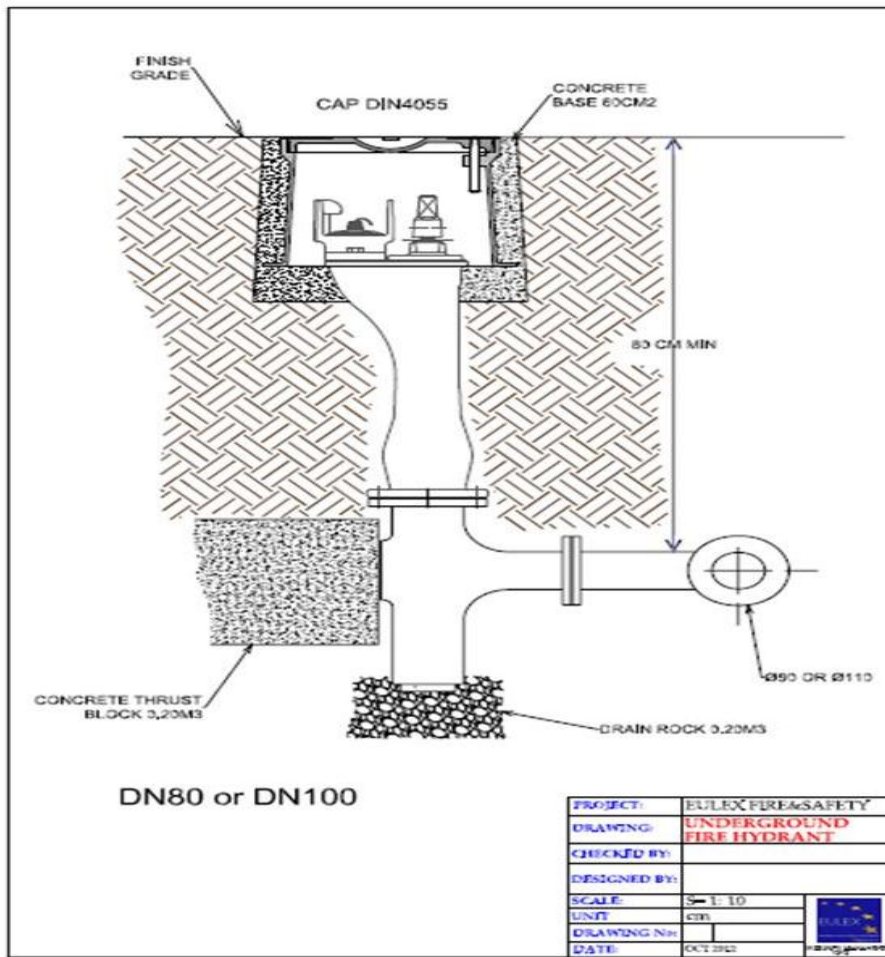

All other terms and conditions of the Tender Dossier remain unchanged. The above alterations and corrections to the Tender Dossier are integral part of the Tender Dossier.

Please regularly check EULEX Website where additional clarifications may be published until **28th December 2012** at <http://www.eulex-kosovo.eu/en/tenders/112-water.php>